

**Louviers Water and Sanitation District  
Systems Report  
February 2023**

**Presented by:  
Semacor Inc.  
3995 S. Castlewood Canyon Rd  
Castle Rock Co. 80104**

## Water System

**Well Flow:** Well, VFD 100 Old. 0.000 MG. Well, VFD 101 New. 0.331MG

**System Flow/Days:** Total Wells = 331,072 11,824 gallons/day

**Well, VFD 100:** Normal Operation,

**Well, VFD 101:** Normal Operation,

**Well Water Level Last month:** 154.1 Feet VFD 100 Old 218.2 Feet VFD 101 New

**Well Water Level This month:** 152.1 Feet VFD 100 Old 219.9 Feet VFD 101 New

**Tank Levels: (17ft = 100%)** Range 15.0 to 16.6 feet

**Tanks:** Normal Operation,

**Pump Station Operation:** Normal Operation,

**Chlorine System:** Normal Operation, 30.6 Lbs. of chlorine.

**Distribution System:** Normal Operation,

**Fire Hydrants:** Normal Operations,

**Meter Readings:** 0,

**Locates:** 20,

## Wastewater System

**Influent Mater:** Total Gallons: 190,546

**Day's: 31** Total: 6,805 GPD

**Chlorine System:** Normal Operation, Used 0 Gallons of chlorine.

**Irrigation Discharged:** Total: 0


## Water sales

**Water Produced Jan/Feb.** Total:  
**Water Revenue Jan/Feb.** Total: = = %

**Misc. /Other:**

	Jan.	Feb.	March	April	May	June	July	Aug.	Sept.	Oct.	Nov.	Dec.	Total
Well 2022	0.03	0.66	0.70	0.75	0.79	1.76	7.93	1.38	1.37	0.81	0.34	0.23	16.75

**Louviers W/S District Well Production**

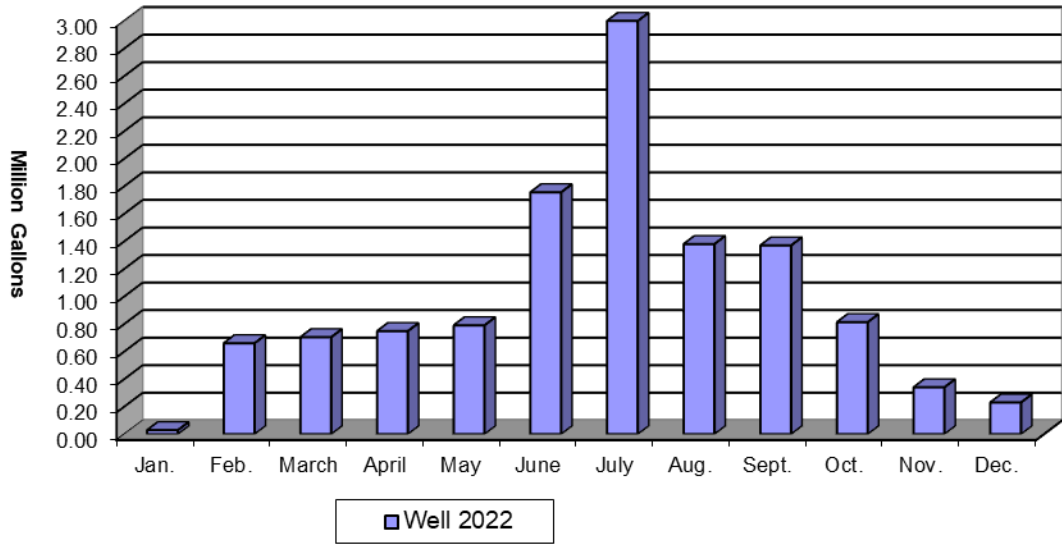

	Jan.	Feb.	March	April	May	June	July	Aug.	Sept.	Oct.	Nov.	Dec.	Total
Well 2023	0.38	0.33	0	0	0	0	0	0	0	0	0.00		0.71

**Louviers W/S District Well Production**

